
Applications

Sequence of Operation

Equipment occupied mode-based on time of day. Controller SZ-1 will open and close the valves to maintain an adjustable heating and cooling temperature setpoint. When the aquastat senses a change from heat to cool or cool to heat it will break or make the DI2 contact to swith the action of the valve.

Unoccupied mode-based on time of day shall operate the same as during the occupied period but with different setpoints. 4 Pipe Fan Coil Unit with 2 Position Valves

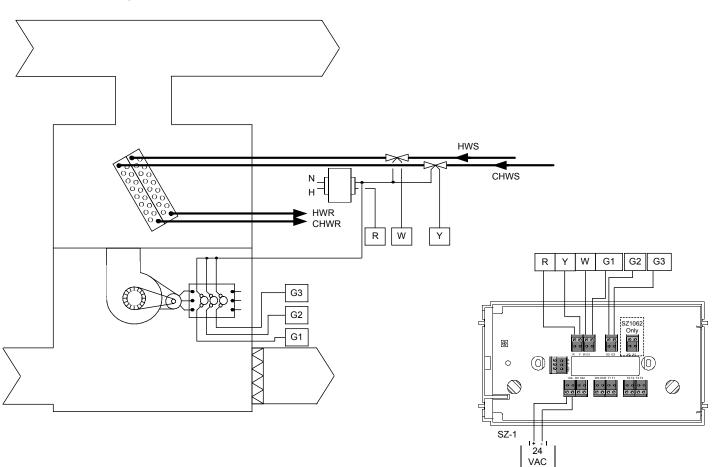

equipment schedule			
ltem	Quantity	Mod. Number	Description
SZ-1	1	SZ1061 or SZ1062	Thermostat

Tes Basys Controls*

2800 LAURA LANE • MIDDLETON, WI 53562 • (800) 288-9383 • FAX (608) 836-9044 • www.tcsbasys.com