


## Sequence of Operation

Chillers 1,2,3 & 4 will be sequenced to maintain chilled water supply or return (program selectable) temperature as indicated. The mixing valve will be modulated to maintain a mixed water temperature. Chillers are set up on a lead/lag sequence.

## Chiller Control with Rotation Sequence

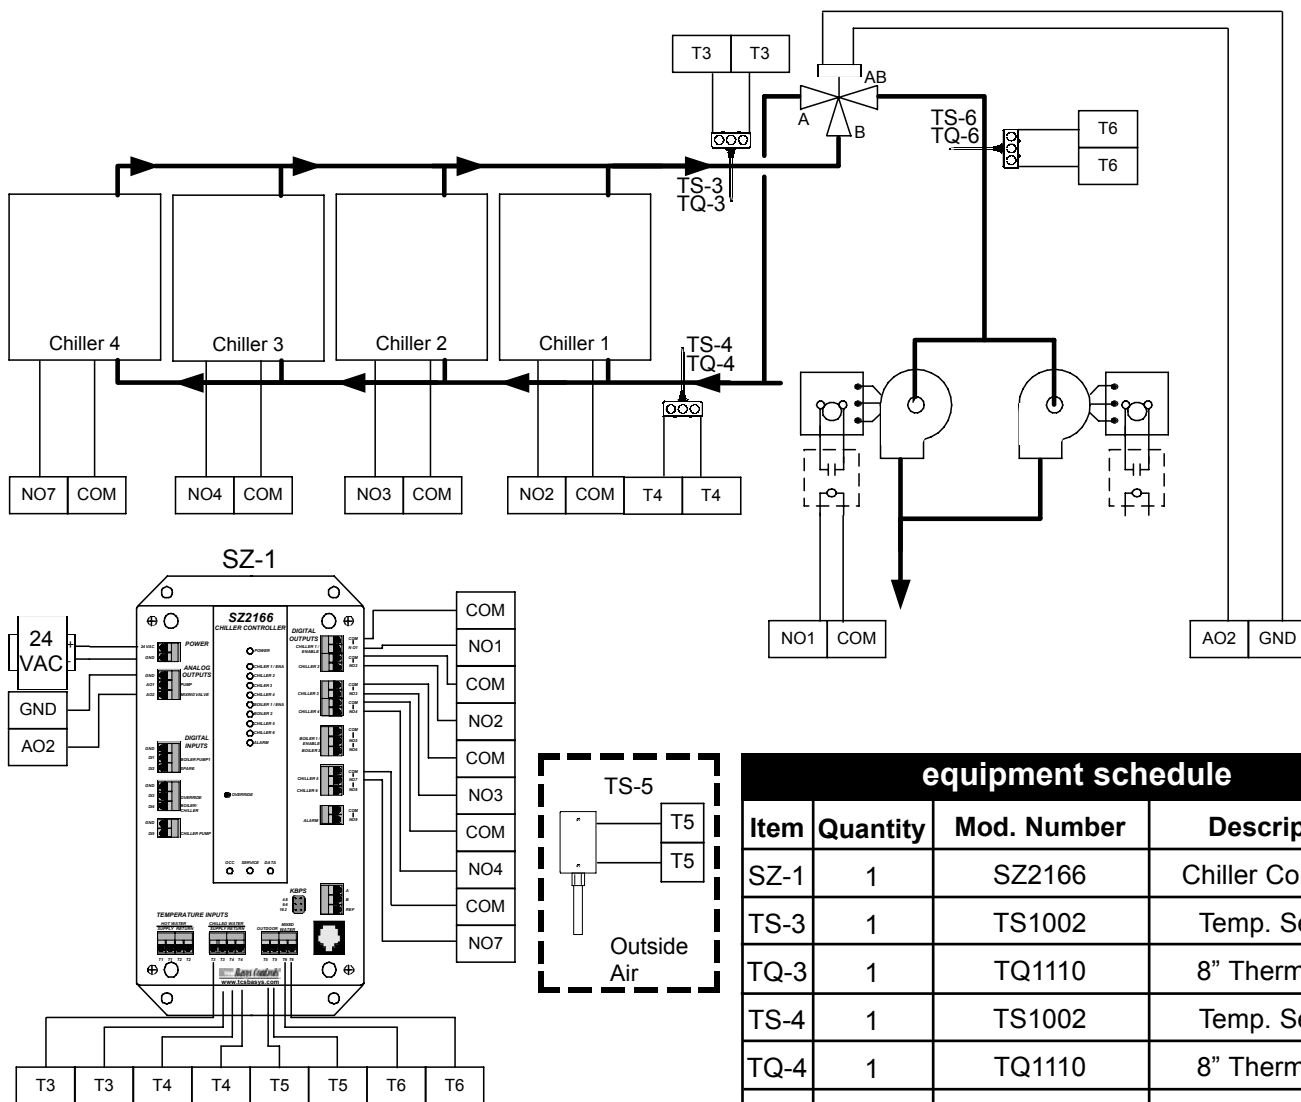

equipment schedule			
Item	Quantity	Mod. Number	Description
SZ-1	1	SZ2166	Chiller Controller
TS-3	1	TS1002	Temp. Sensor
TQ-3	1	TQ1110	8" Thermowell
TS-4	1	TS1002	Temp. Sensor
TQ-4	1	TQ1110	8" Thermowell
TS-5	1	TS1003	Outdoor Sensor
TS-6	1	TS1002	Temp. Sensor
TQ-6	1	TQ1110	8" Thermowell