


Sequence of Operation

Equipment occupied mode - based on time of day. Controller SZ-1 will cycle equipment to maintain an adjustable heating and cooling temperature setpoint.

Terminals A1 and A2 will turn on or open the packaged economizer or fresh air damper during the occupied time period.

Unoccupied mode - based on time of day shall operate the same as during the occupied period but with different setpoints.

Rooftop Unit with Packaged Economizer or Occupied Fresh Air

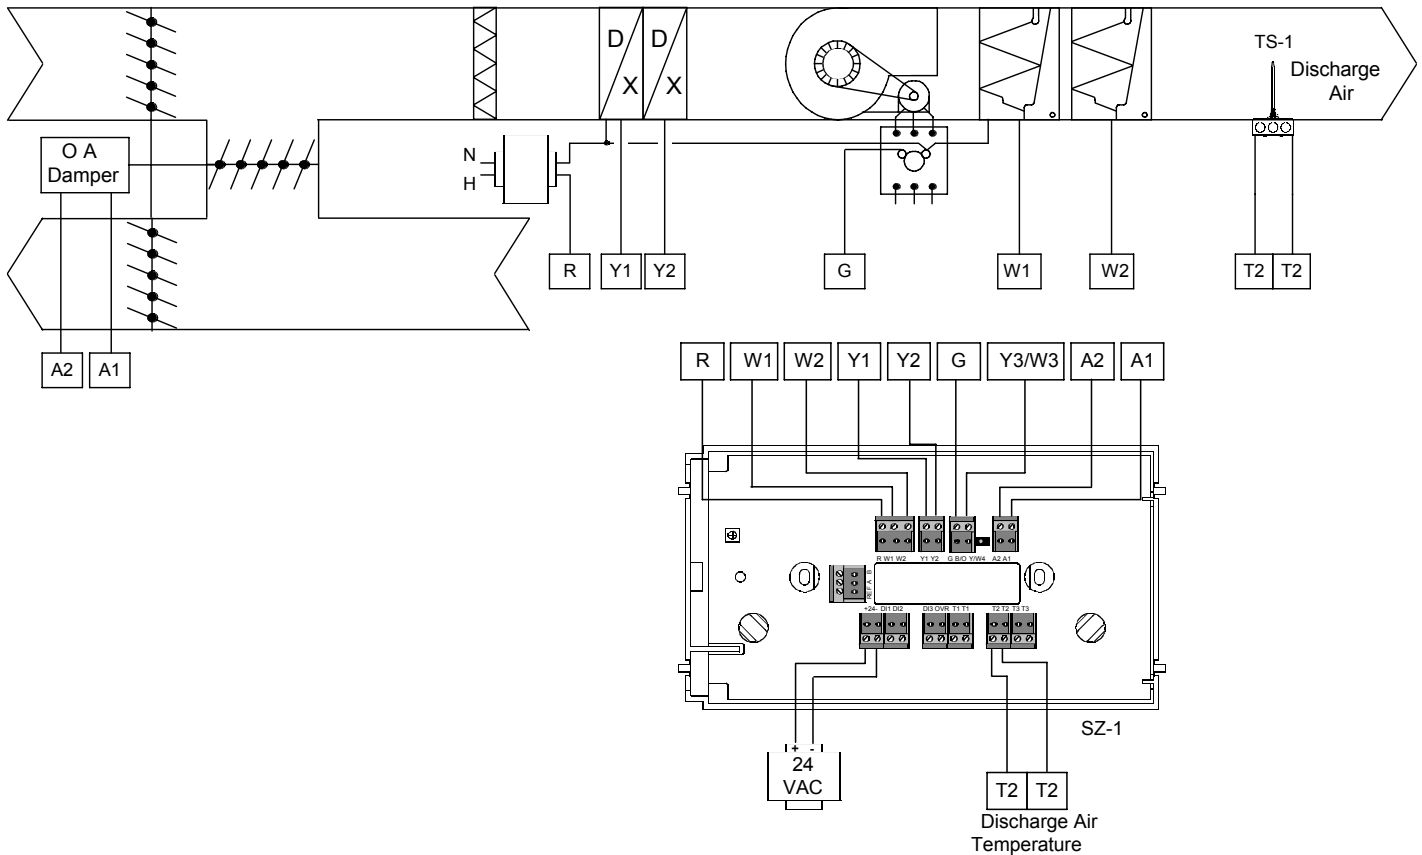

* Gives a NO or NC signal during the occupied mode.

equipment schedule			
Item	Quantity	Mod. Number	Description
SZ-1	1	SZ1022, SZ1031 or SZ1035	Thermostat
TS-1	1	TS1002	D.A. Sensor