


Sequence of Operation

Equipment occupied mode - based on time of day. Controller SZ-1 will modulate the reheat terminal based on an adjustable setpoint to maintain zone temperature.

Unoccupied mode-based on time of day, shall operate the same as during the occupied period but with different setpoints.

Single Duct Zone Reheat Terminal Unit

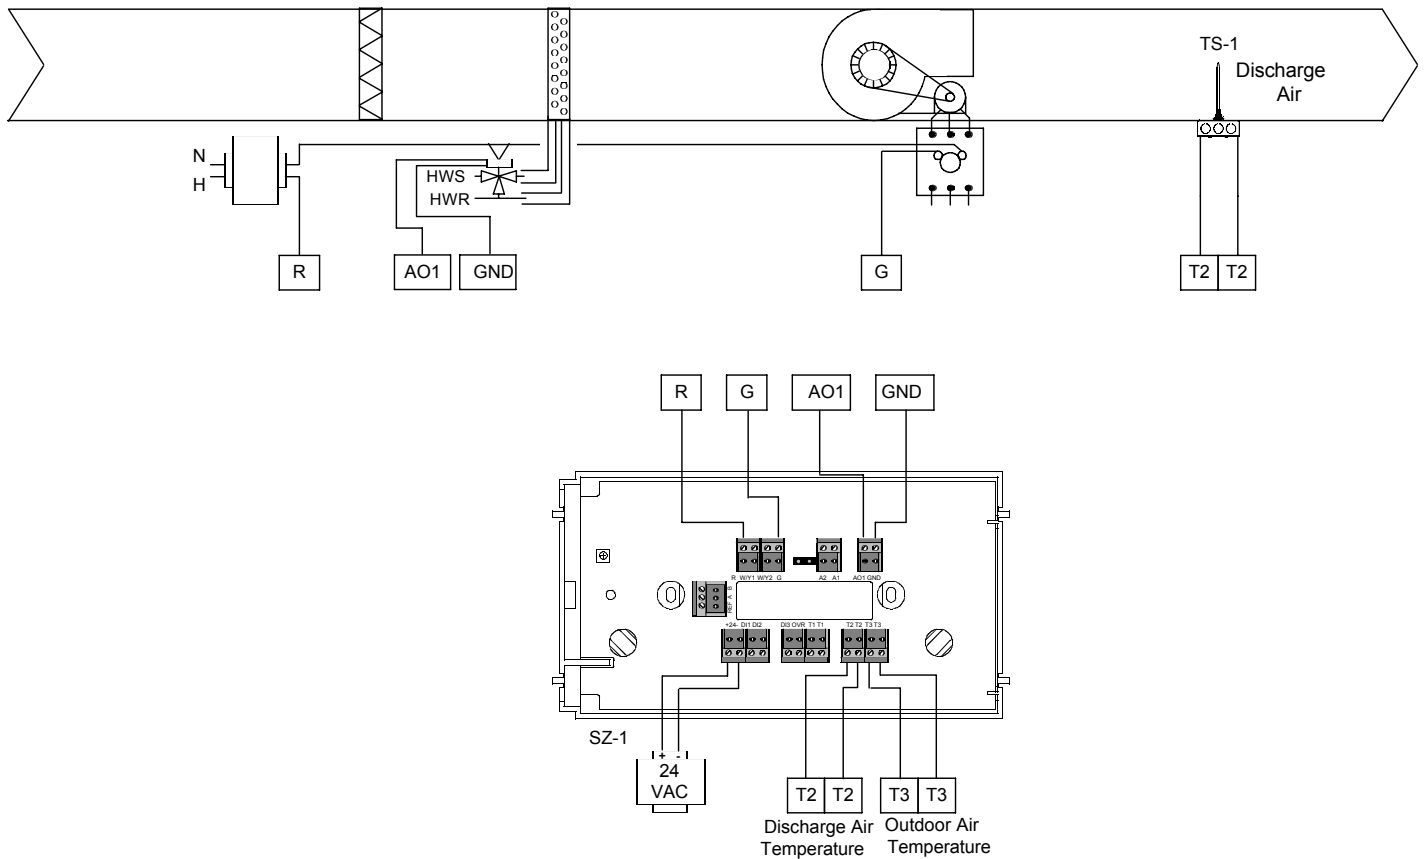

equipment schedule			
Item	Quantity	Mod. Number	Description
SZ-1	1	SZ1017a	Thermostat
TS-1	1	TS1002	D.A. Sensor
TS-2	1	TS1003	O.A. Sensor

