


## Sequence of Operation

Equipment occupied mode-based on time of day. Controller SZ-1 will cycle equipment to maintain an adjustable heating and cooling temperature setpoint.

Unoccupied mode-based on time of day shall operate the same as during the occupied period but with different setpoints.

## 2 Pipe Fan Coil Unit with Modulating Valve

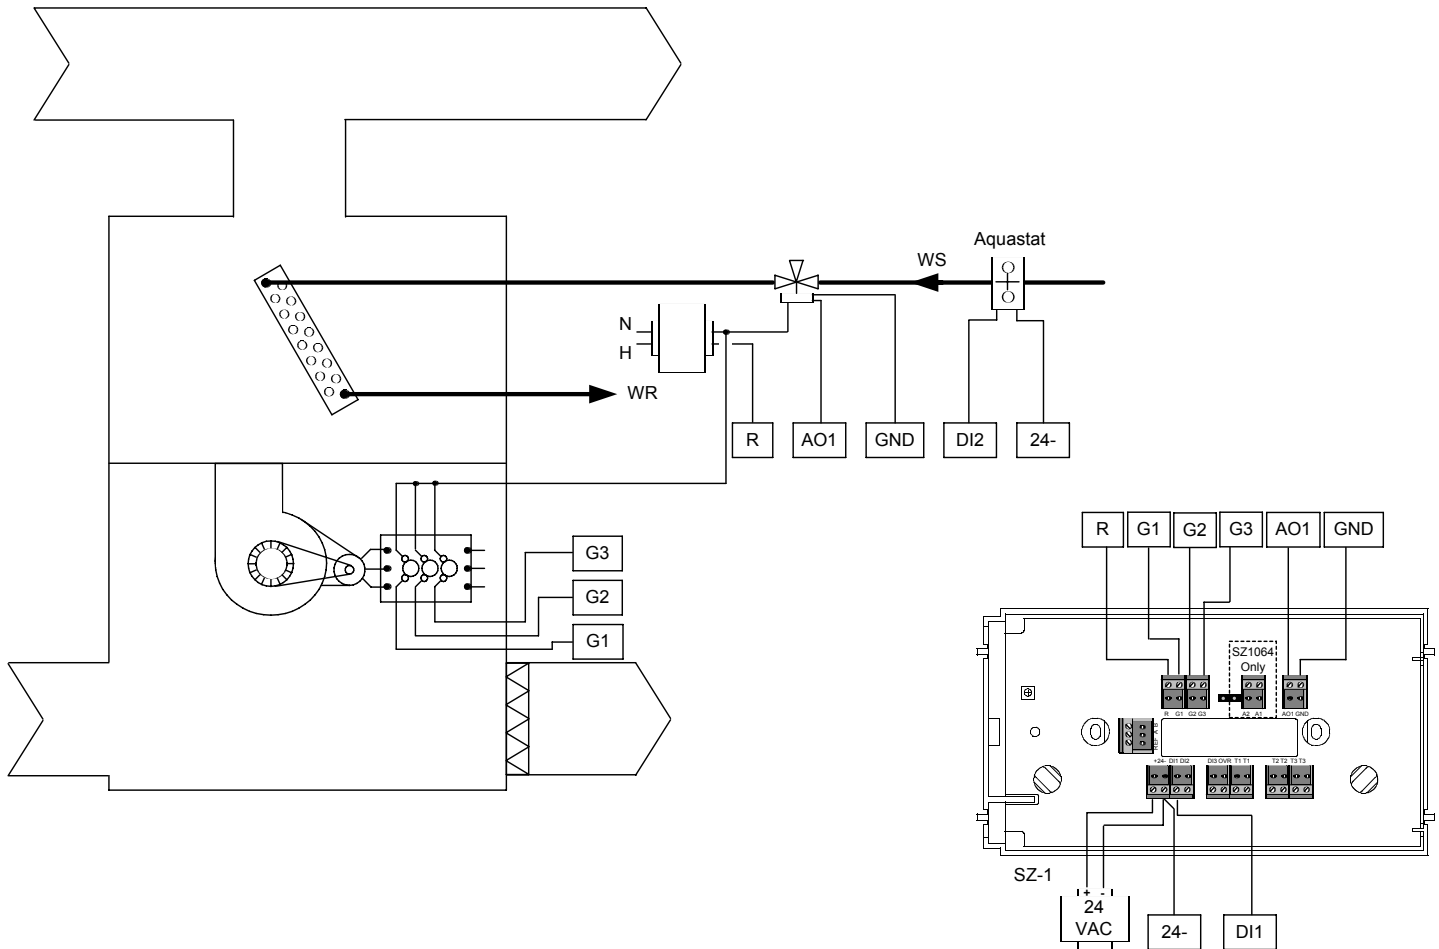

equipment schedule			
Item	Quantity	Mod. Number	Description
SZ-1	1	SZ1063 or SZ1064	Thermostat