


## Sequence of Operation

Equipment occupied mode - based on time of day.  
Controller SZ-1 will cycle equipment to maintain an adjustable heating and cooling temperature setpoint.

Controller SZ-A will cycle cooling stage one to maintain an adjustable dehumidification setpoint. If room temperature should drop below desired temperature stage one of heating shall turn on to reheat.

Unoccupied mode - based on time of day, shall operate the same as during the occupied period but with different setpoints.

## DX Cooling with Dehumidification and Reheat

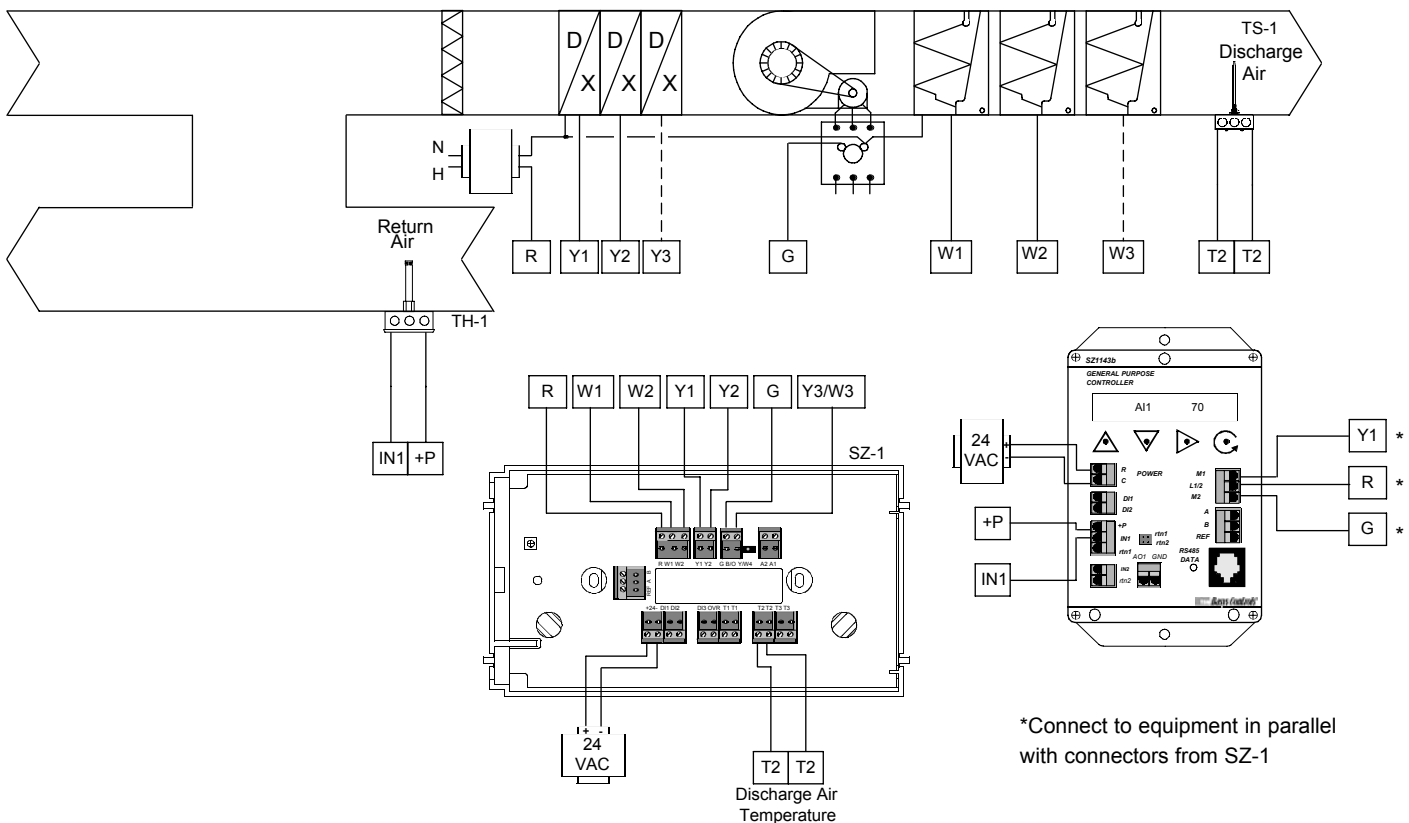

equipment schedule			
Item	Quantity	Mod. Number	Description
SZ-1	1	SZ1009, SZ1022, SZ1031 or SZ1035	Thermostat
SZ-A	1	SZ1143b	Controller
TS-1	1	TS1002	D.A. Sensor
TH-1	1	TH1021	Humidity Sensor