


Forced Air Zoning

Sequence of Operation

Controller SZ-1 shall maintain the discharge air heating and cooling setpoint. Thermostat SZ-3 shall modulate a zone damper to maintain a zone setpoint. Network discharge air sharing will determine whether SZ-1 is providing heating or cooling.

Controller SZ-2 shall maintain duct static pressure by modulating the relief damper.

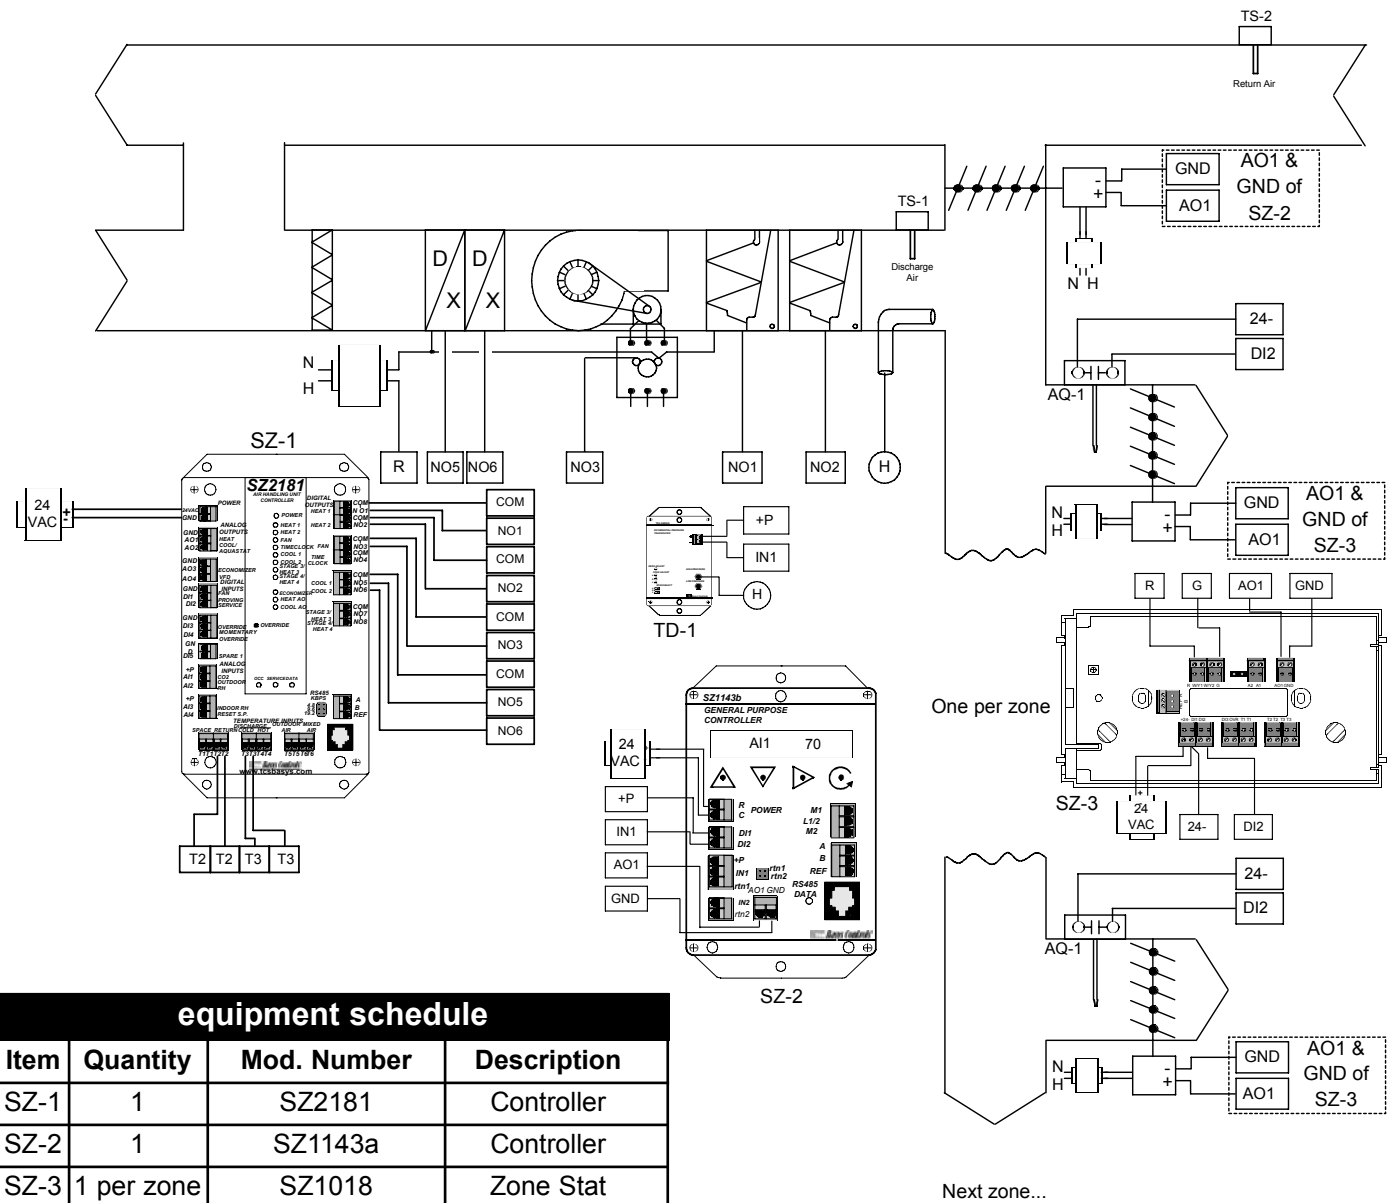

equipment schedule			
Item	Quantity	Mod. Number	Description
SZ-1	1	SZ2181	Controller
SZ-2	1	SZ1143a	Controller
SZ-3	1 per zone	SZ1018	Zone Stat
TS-1	1	TS1002	D.A. Sensor
TS-2	1	TS1002	R.A. Sensor
TD-1	1	TD1190	Pressure Sensor